





REPLACEMENT SHEET


FIG.1

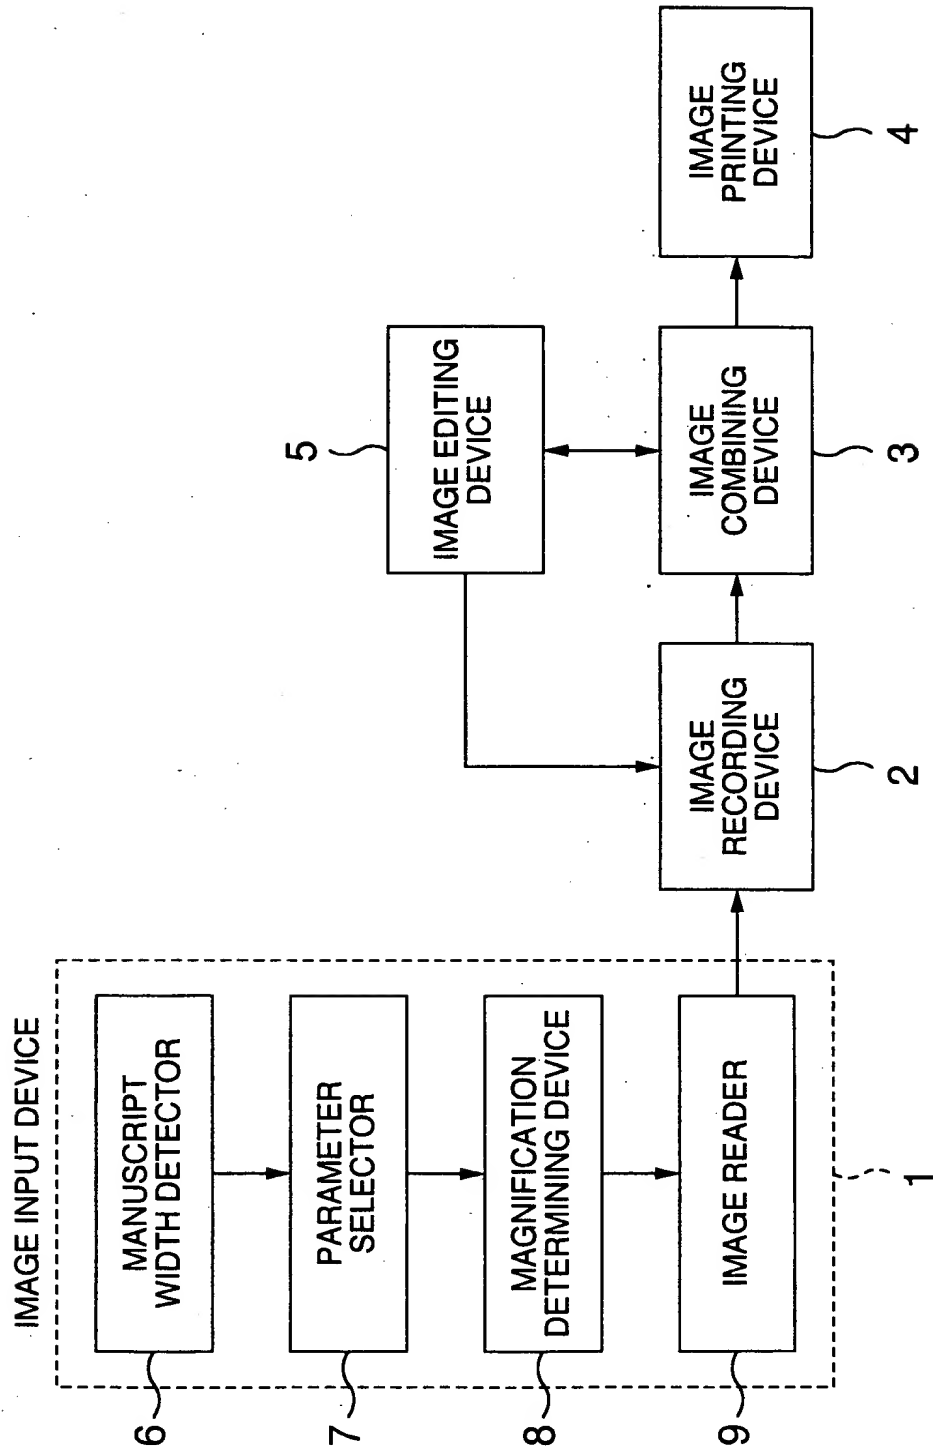



REPLACEMENT SHEET


FIG.2

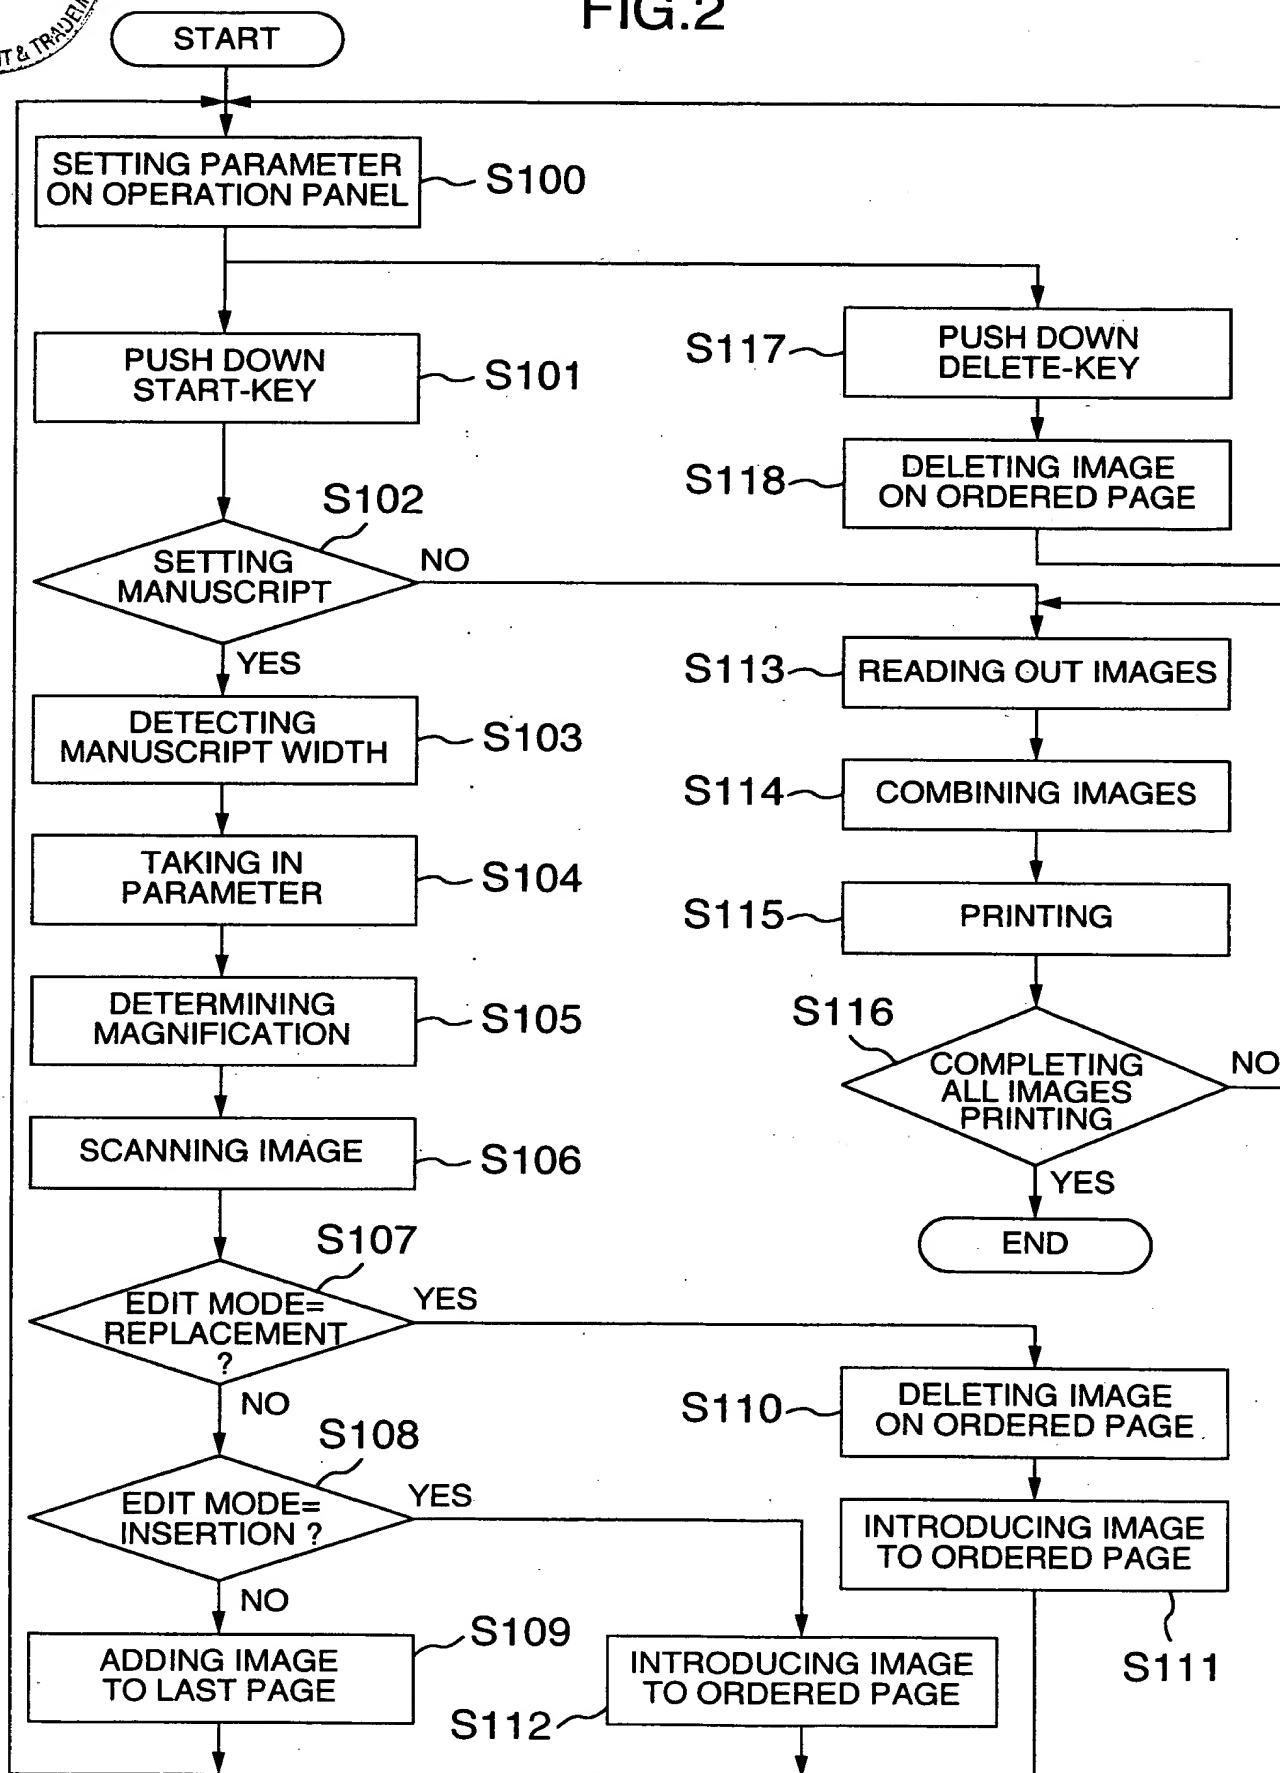




REPLACEMENT SHEET


FIG.3

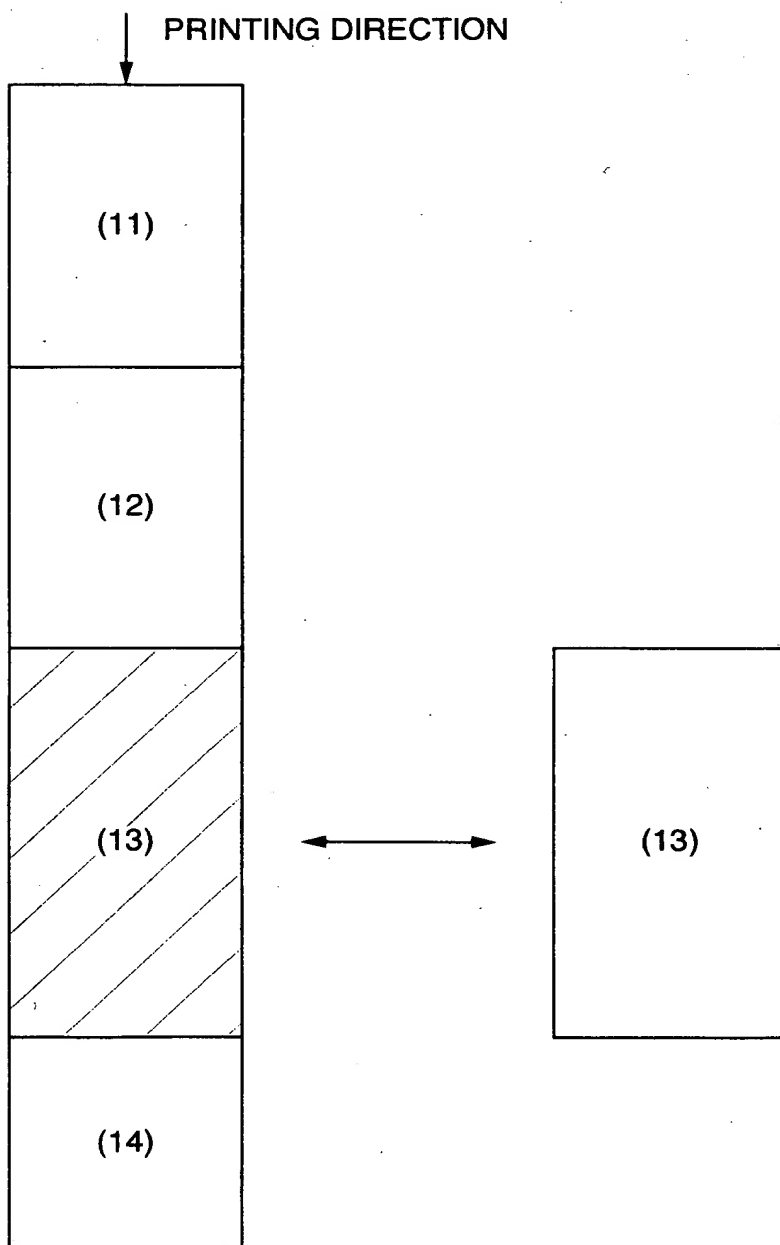




REPLACEMENT SHEET


FIG.4

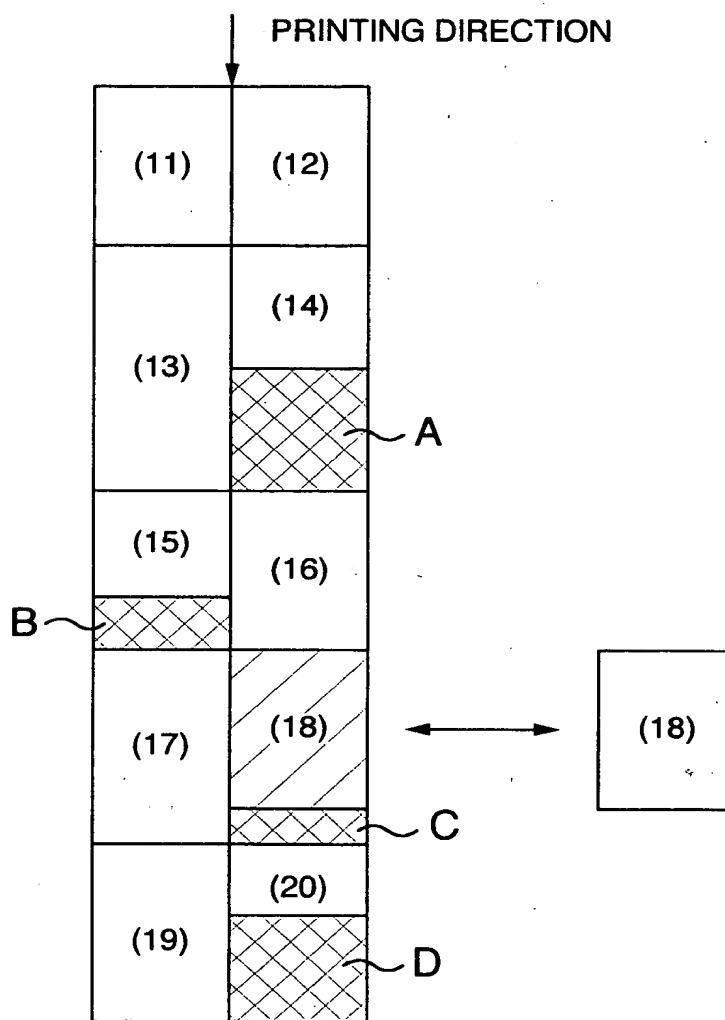




REPLACEMENT SHEET


FIG.5

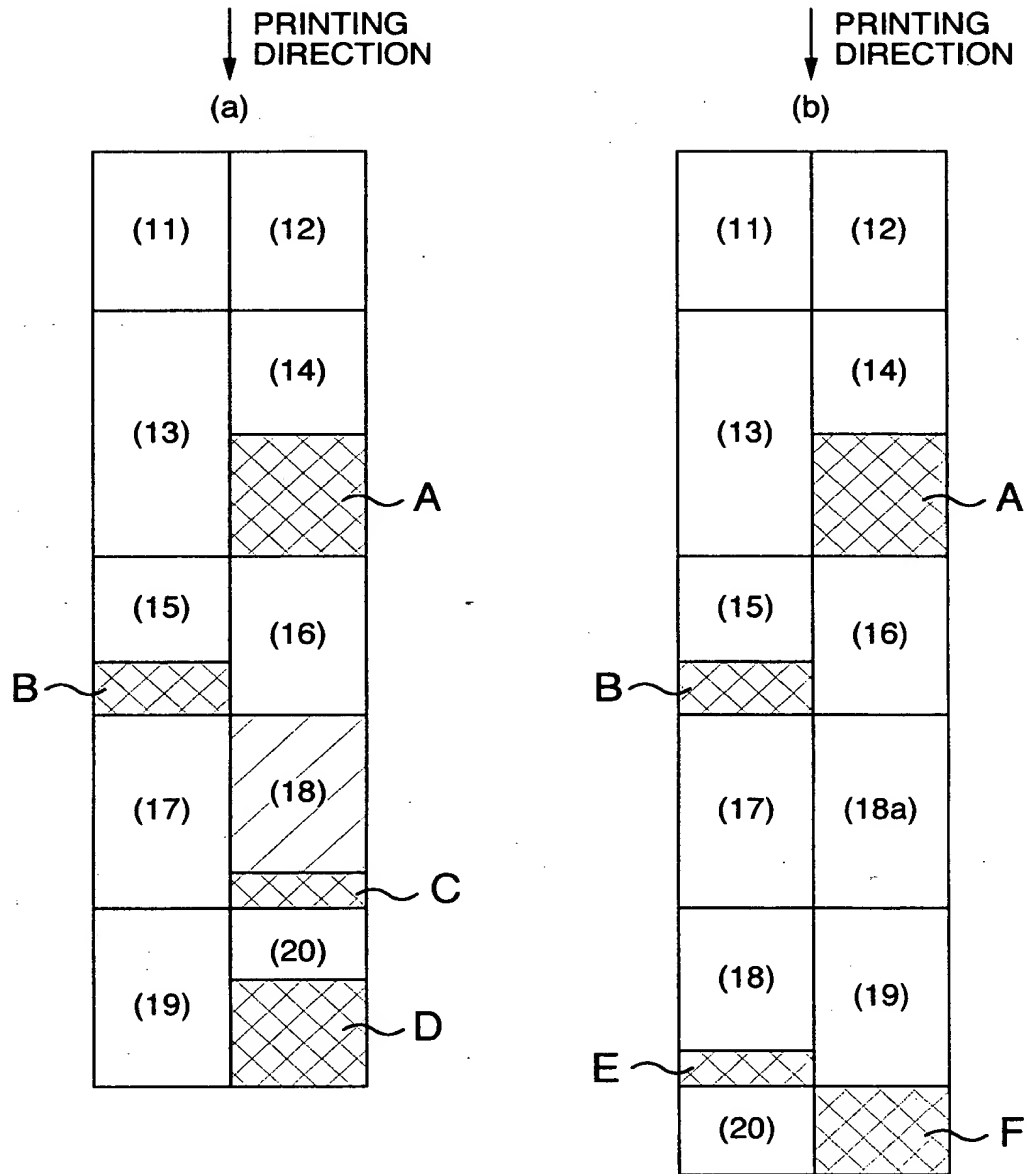




REPLACEMENT SHEET


FIG.6

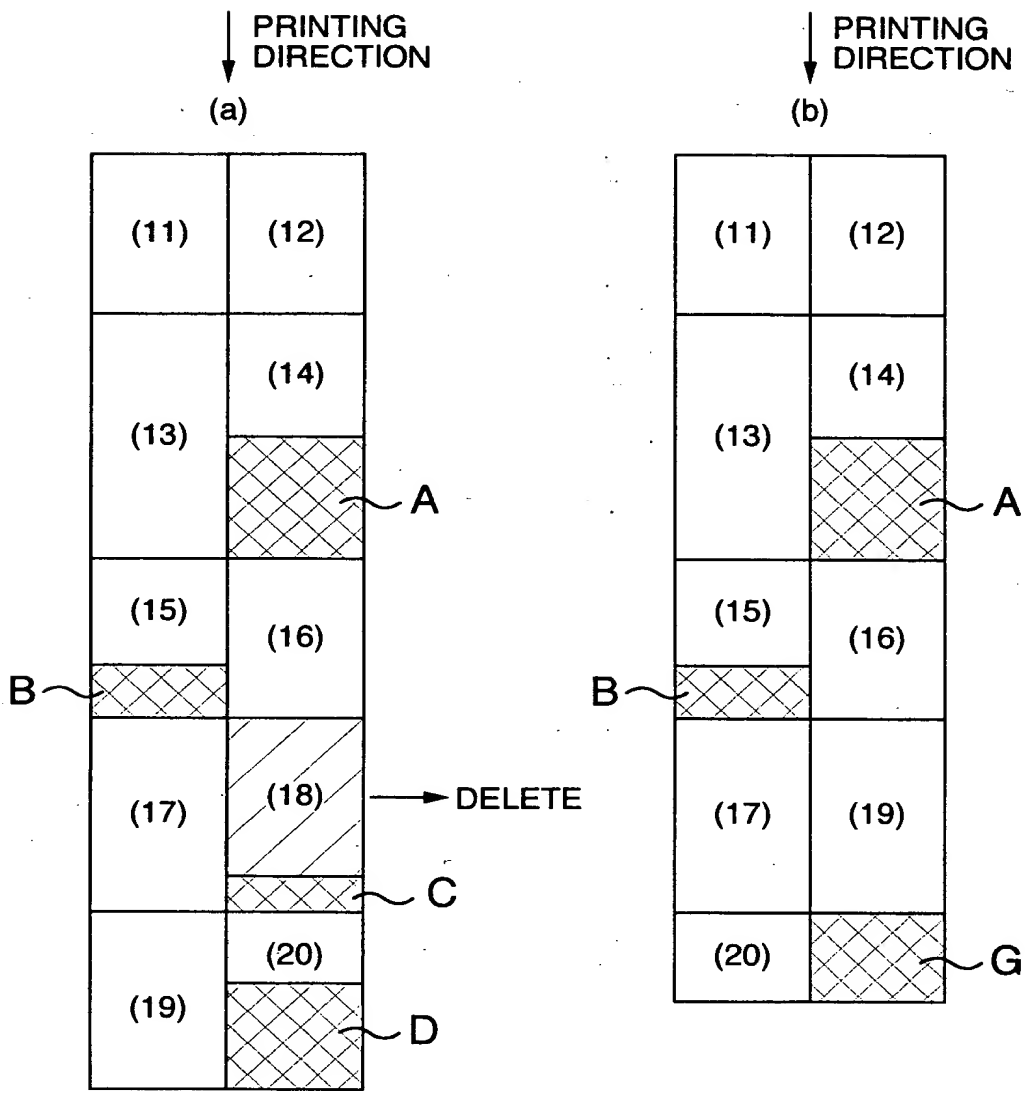




REPLACEMENT SHEET


FIG.7

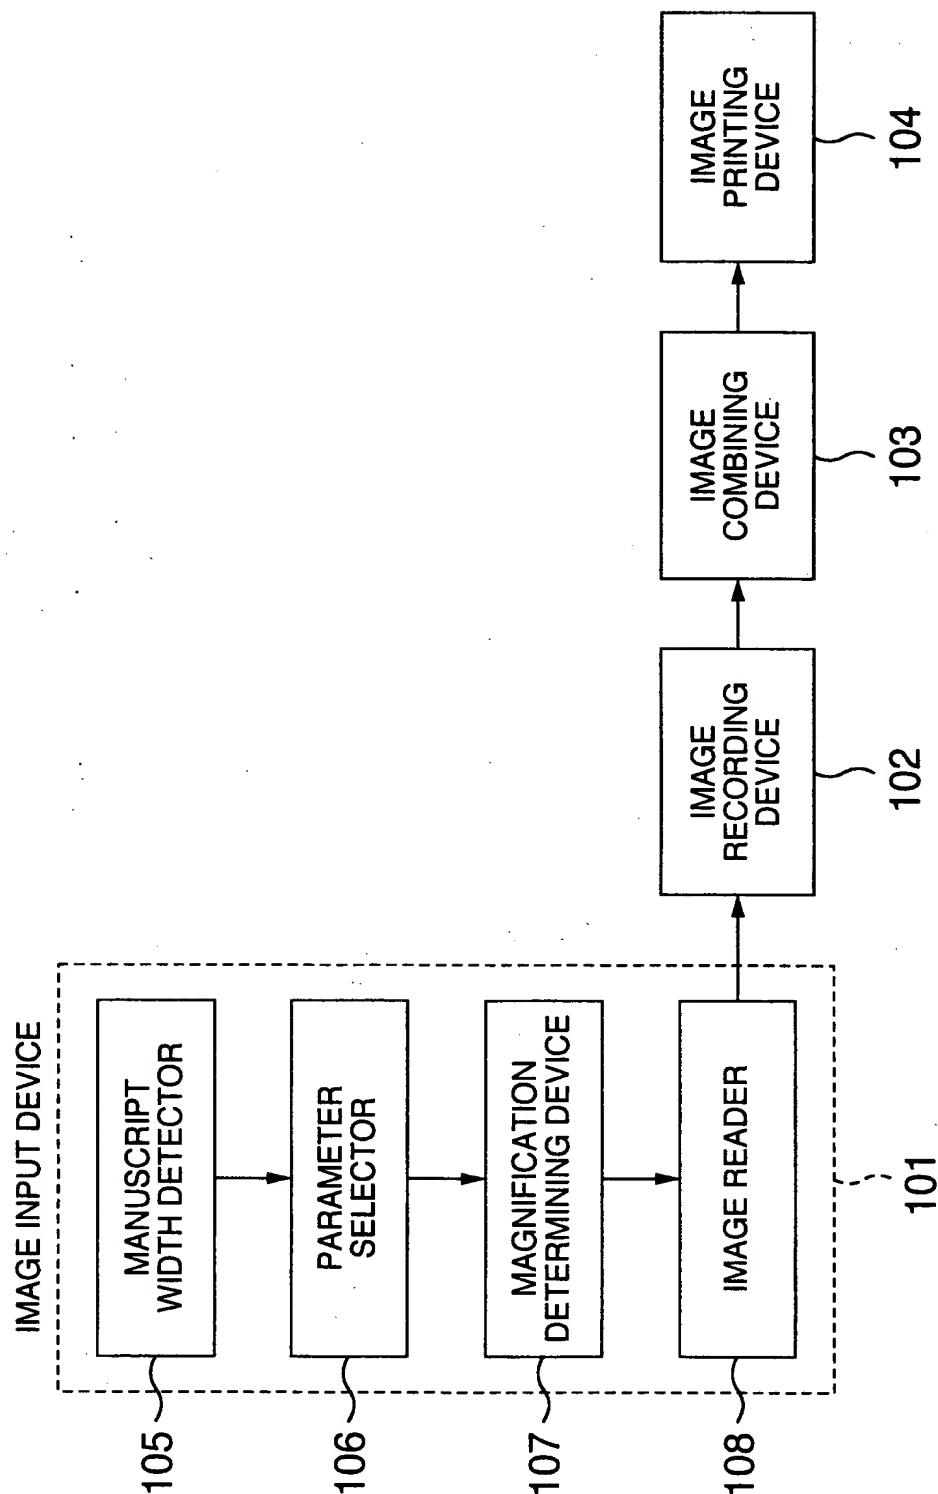

REPLACEMENT SHEET


FIG.8

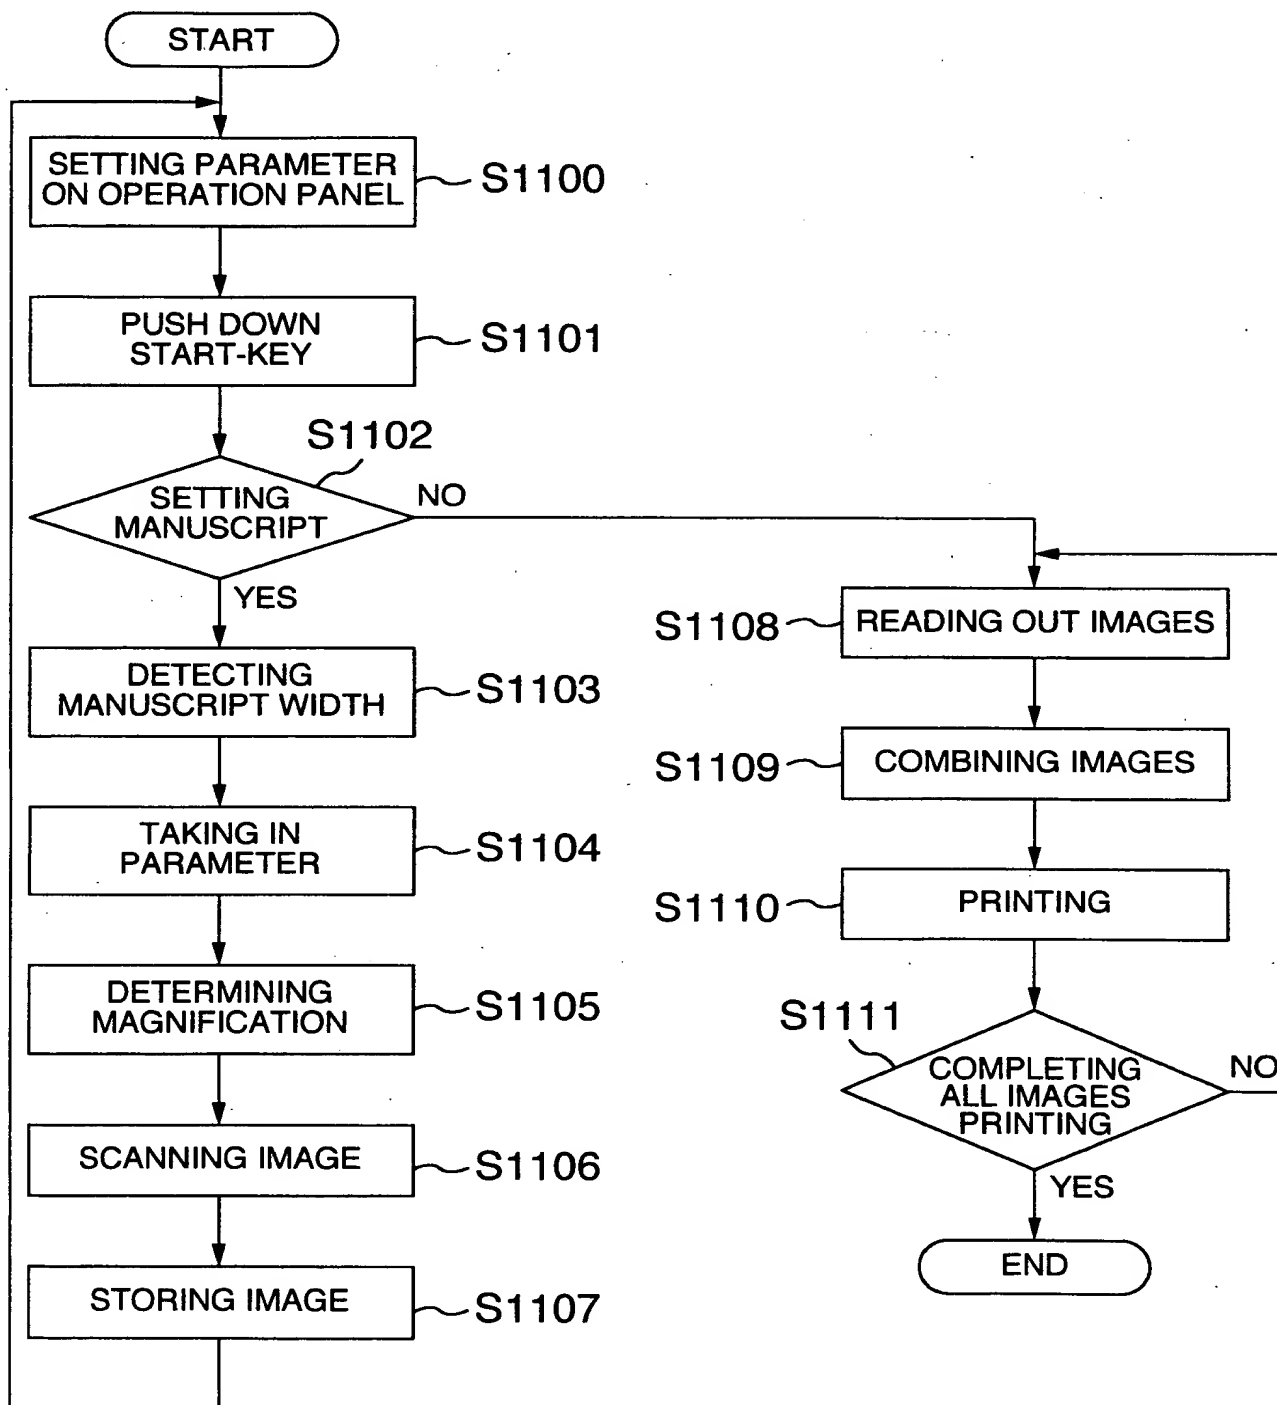




REPLACEMENT SHEET


FIG.9

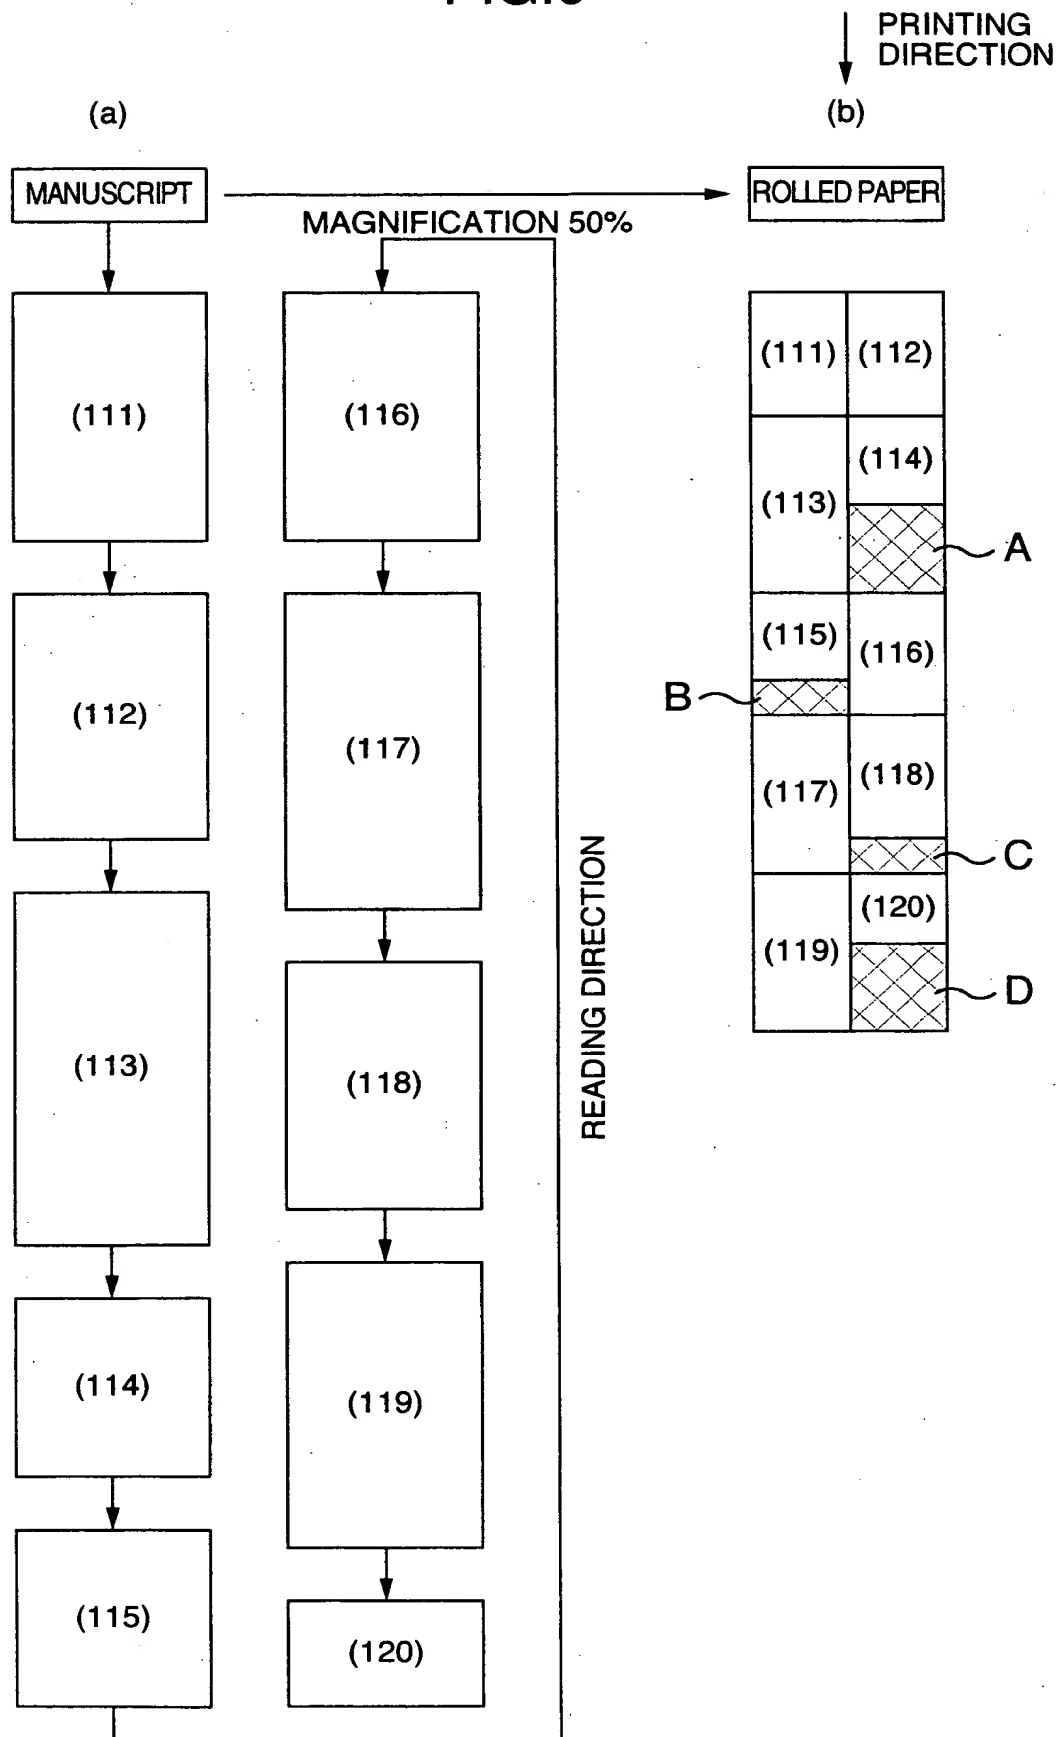




REPLACEMENT SHEET


FIG.10

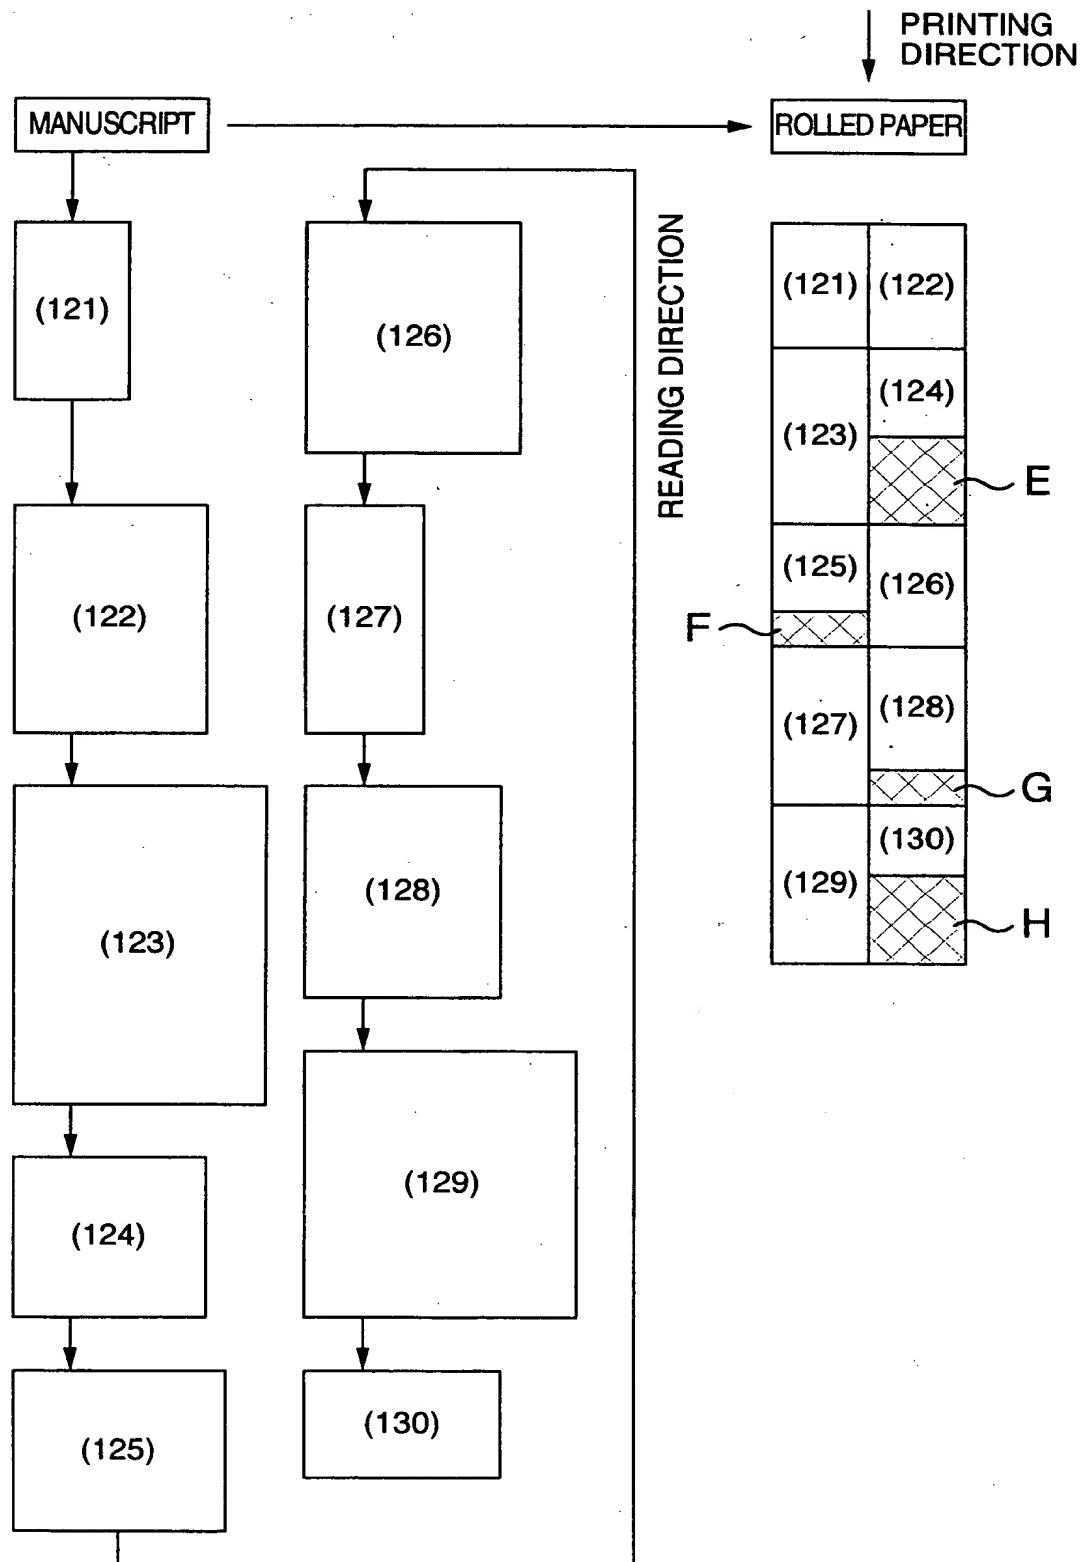




REPLACEMENT SHEET

FIG.11

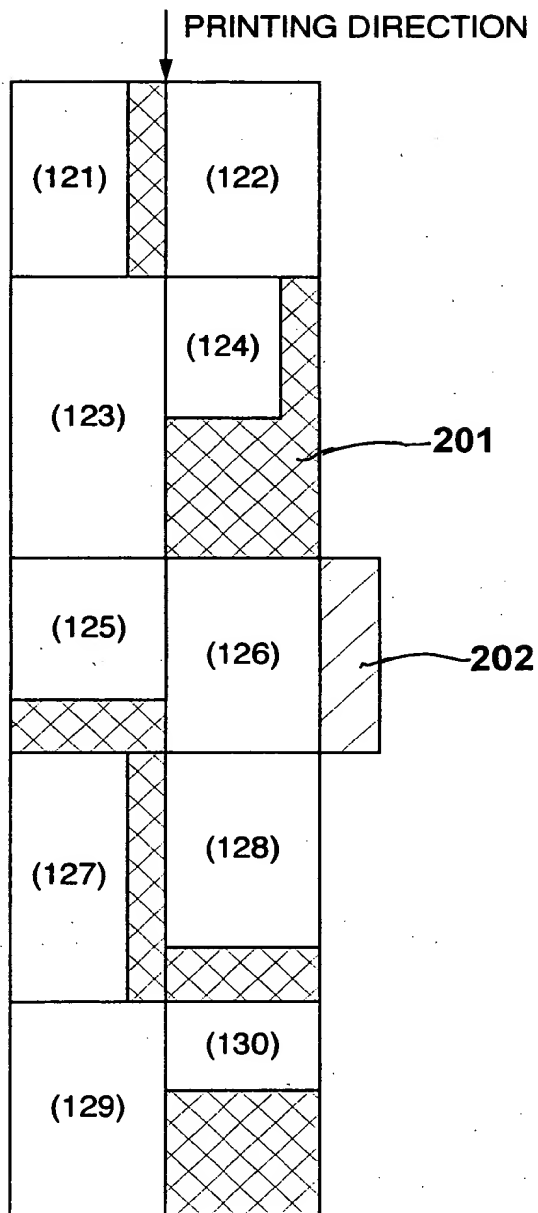



REPLACEMENT SHEET

FIG.12

